PLANA: Antibacterial 1P 16AX 1-way switch

14001.AB

Wiring devices / Traditional wiring devices / PLANA / Devices



Antibacterial 1P 16AX 1-way switch

1P 16 AX 250 V~ 1-way switch, lightable, replaceable button, with antibacterial treatment, white. Max 200 W for self-ballasted lamps (IEC 60669-1:2017)


Product Status

3 - Active


Minimum order quantity

50 NR


Drawings

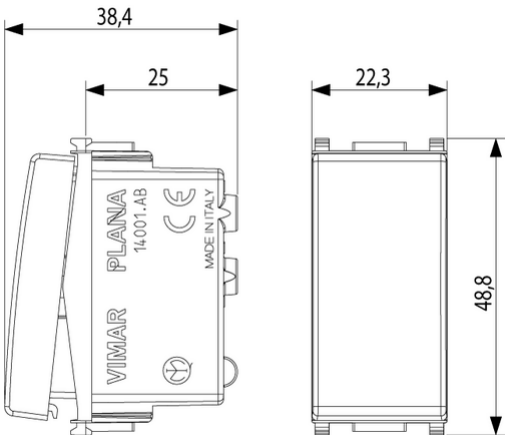

Space view

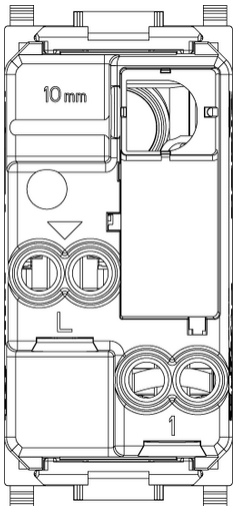

Backside view

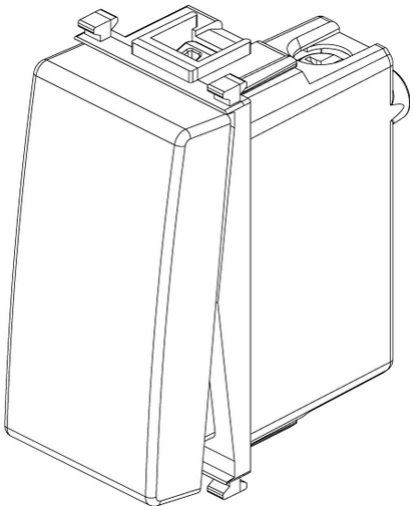

3D View

Certifications

- **00. CE Marking - EU**
- **01. IMQ - Italy (download)**
- **20. IQC - Argentina**
- **26. SASO - Saudi Arabia (download)**
- **31. TISI - Thailand**
- **37. Marking - Morocco**
- **96. Electrotechnical expert (download)**
- **99. WEEE Directive (download)**

Technical data

Class group: Domestic switching devices

Class: Installation switch

Wiring system: Switch 1-pole

Operating method: Rocker/button

Assembly arrangement: Modular device for domestic switching devices

Number of modules (module system): 1

Push button switch: Yes

Number of rockers: 1

Mounting method: Flush-mounted

Type of fastening: Engage (snap)

With mounting plate: No

Material: Plastic

Material quality: Thermoplastic

Halogen free: Yes

Surface protection: Untreated

Surface finishing: Glossy

Colour: White

RAL-number (similar): 9003

Label space/information surface: Yes

Lighting: Optional

Function lighting: Control and orientation

Type of lighting: LED exchangeable

Suitable for degree of protection (IP): IP40

Nominal voltage: 250 V

Rated current: 16,00 A

Monitoring contact: No

Connection type: Screwed terminal

Washing machine switch: No

Device width: 22,30 mm

Device height: 49,00 mm

Device depth: 38,40 mm

Built-in depth: 24,00 mm

Packaging



8007352499317

Qtà	1 NR
Dim	4.1x2.8x5.3 [cm]
Weight	28.1 [g]



8007352499324

Qtà	50 NR
Dim	21.6x11.6x14.3 [cm]
Weight	1,508 [g]



8007352640740

Qtà	500 NR
Dim	57.5x22.5x30 [cm]
Weight	15,570 [g]

Legal

Vimar reserves the right to change at any time and without notice the characteristics of the products reported.Installation should be carried out by qualified staff in compliance with the current regulations regarding the installation of electrical equipment in the country where the products are installed.For the terms of use of the information on the product info sheet see Condizioni di utilizzo.